



lumini Solucoes em Iluminacao LTDA  
www.lumini.com.br  
Email:laboratorio@lumini.com.br  
Tel:+55 11 3437-5555 Fax:+55 11 3437-5555  
Address:Rua Ferreira Viana, 716 - Socorro - São Paulo/SP

---

## lumini

---

LumCAT:

Luminaire: concentra flex 34 c serie 3 fc

LampCAT: modulo led 24W 30K irc 90

Ballast type: led driver 700mA

Report No:

Voltage(V): 127.6200

Test No:

Current(A): 0.2050

Number of Lamps: 1

Power (W): 25.9730

Lamp flux(lm): 2715.0

PF: 0.9940

Length(mm): 309

Width(mm): 17

Phm Type: C

Height(mm): 0

---

## Photometric Results

---



Lumens(lm): 1904.99, Efficiency(%): 70.17% , Luminous Efficacy(lm/W): 73.35

Central intensity(cd): 10914.600, Maximum intensity(cd): 10914.600


Angle of maximum intensity: C=0.0  $\gamma$ =0.0

Beam angle of C0 plane : 20.45


Aveage BeamAngle(IEC 61341):20.45

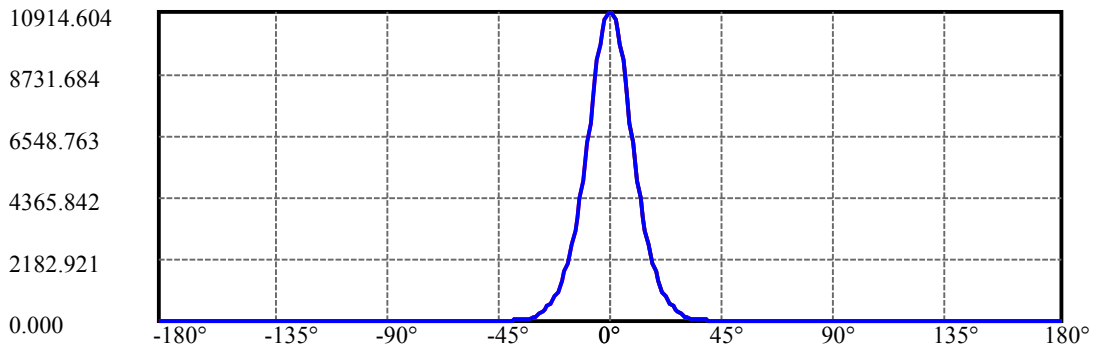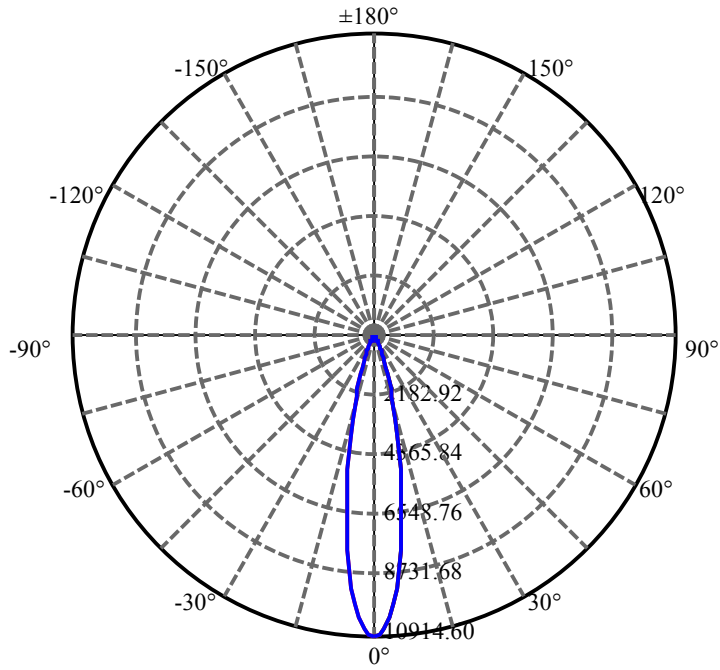

C0(Max): —————  
C0/C180: —————  
C90/C270: —————

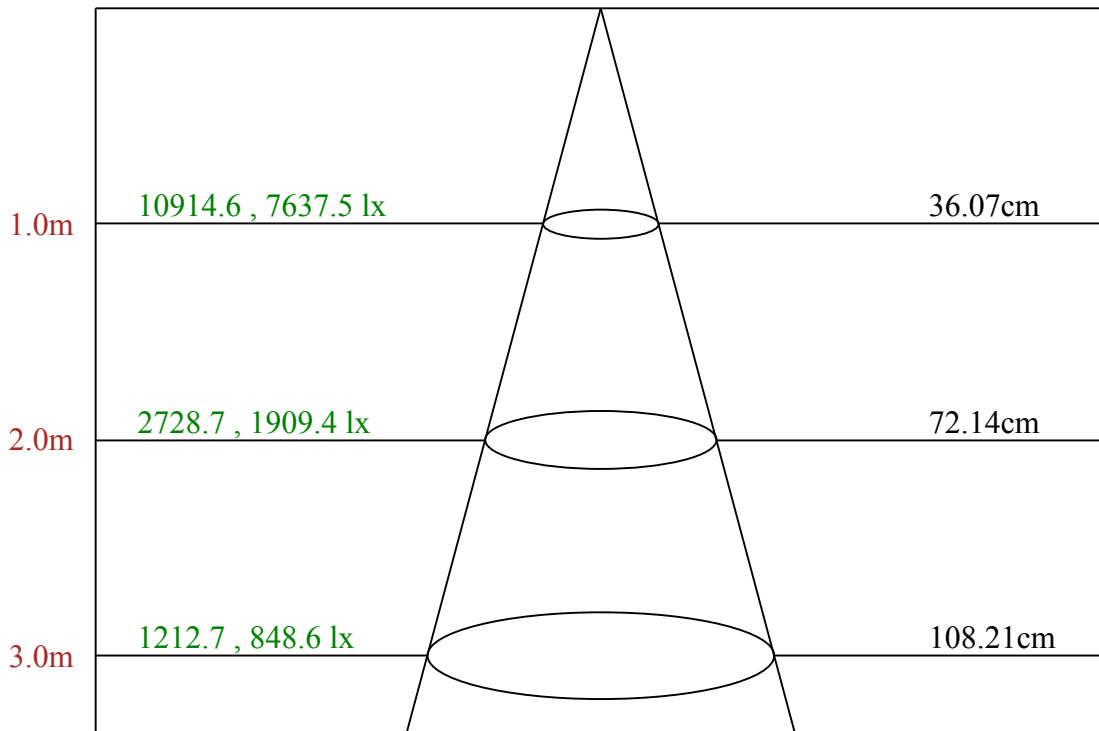

Max , Ave      Beam angle of C0 plane 20.45

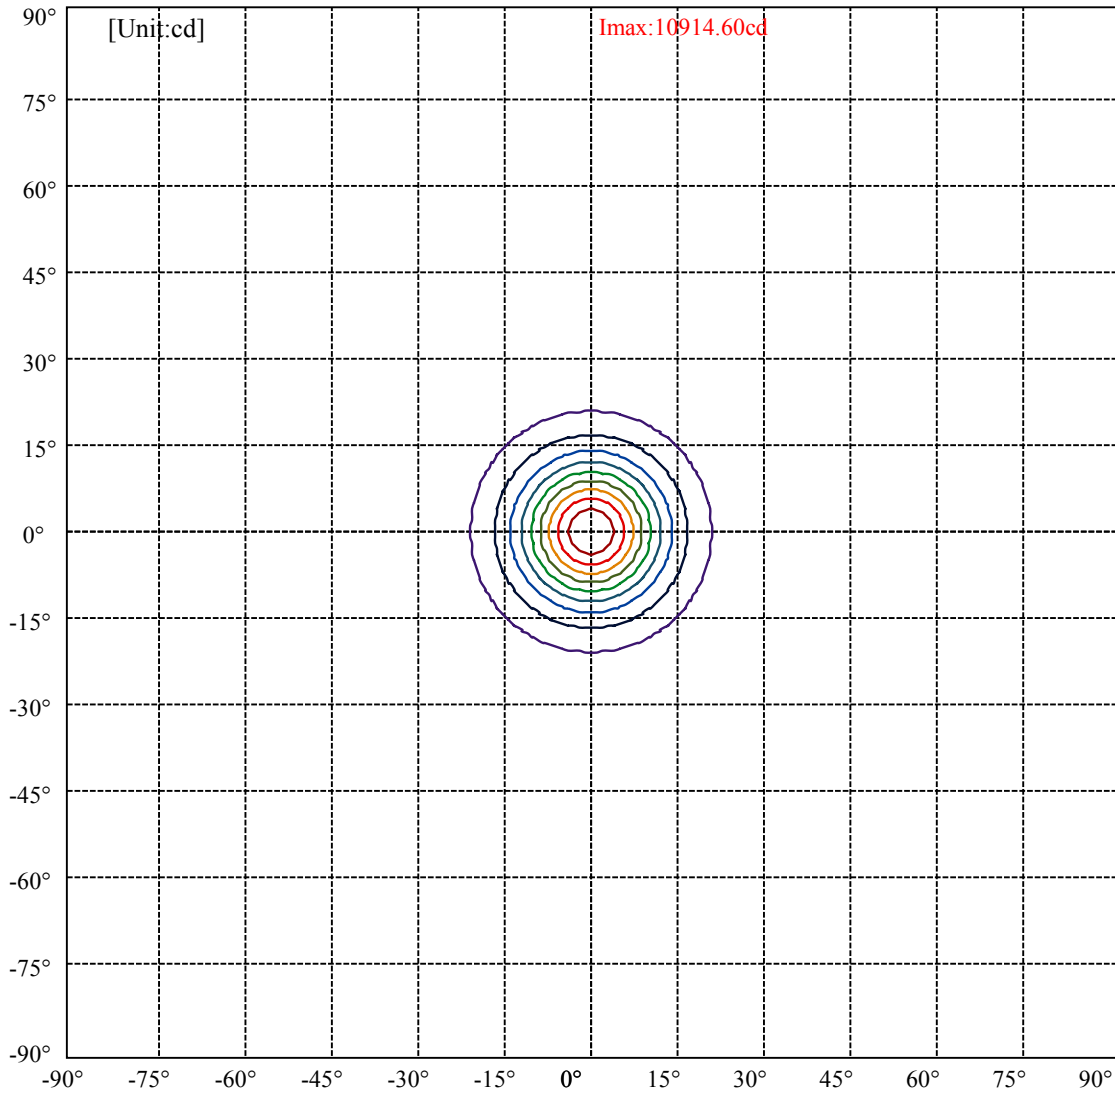

(10%Imax) 1091.46	—
(20%Imax) 2182.92	—
(30%Imax) 3274.38	—
(40%Imax) 4365.84	—
(50%Imax) 5457.3	—
(60%Imax) 6548.76	—
(70%Imax) 7640.22	—
(80%Imax) 8731.68	—
(90%Imax) 9823.14	—

lumini

Luminance Limiting Curve(no luminous side)

Luminance Table


$\gamma$	45	50	55	60	65	70	75	80	85
C0	5322	3980	3099	2742	2882	3339	4250	6198	12180
C45	5322	3980	3099	2742	2882	3339	4250	6198	12180
C90	5322	3980	3099	2742	2882	3339	4250	6198	12180

L(Hor)(65)	L(Ver)(65)	L45(65)	L(Hor)(75)	L(Ver)(75)	L45(75)	L(Hor)(85)	L(Ver)(85)	L45(85)
2882	2882	2882	4250	4250	4250	12180	12180	12180

Glare Table

Glare	Quality	Service Values Illuminance(lx)							
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300
		a	b	c	d	e	f	g	h

Luminance Limiting Curve

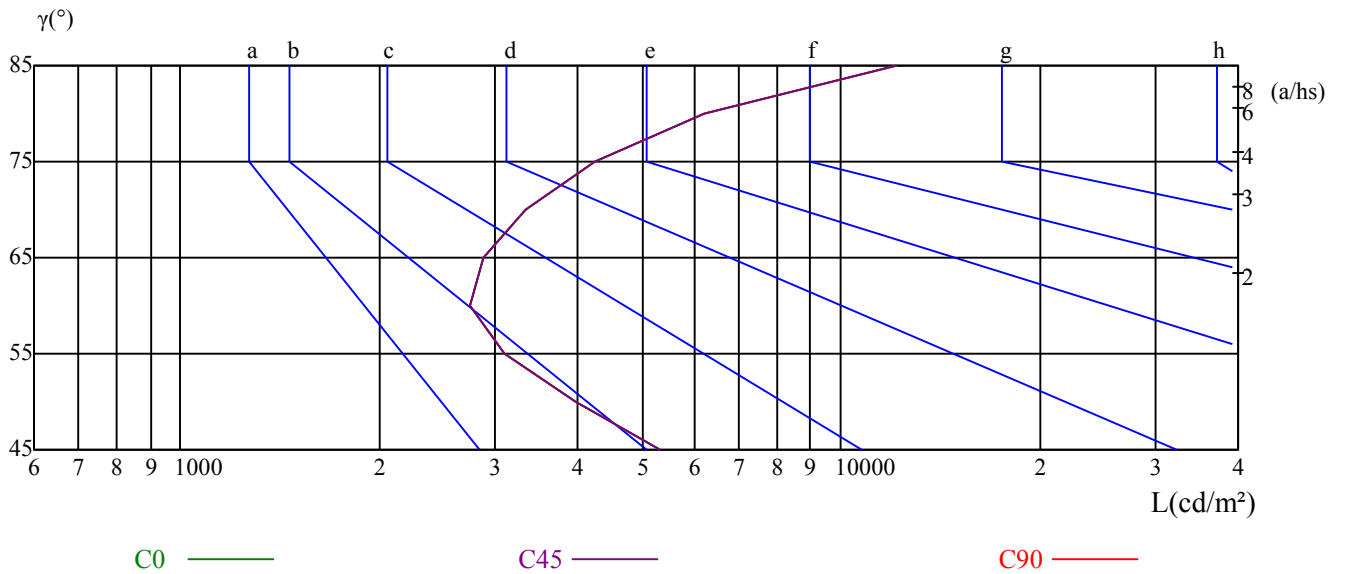

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	9.07	9.96	9.47	10.32	10.69	8.91	9.81	9.31	10.16	10.53
	3H	9.68	10.47	10.10	10.85	11.25	9.53	10.33	9.96	10.71	11.10
	4H	10.26	10.99	10.70	11.39	11.80	10.12	10.85	10.56	11.25	11.67
	6H	11.19	11.87	11.65	12.28	12.73	11.07	11.74	11.52	12.16	12.60
	8H	11.83	12.47	12.29	12.90	13.35	11.71	12.35	12.17	12.78	13.24
	12H	12.68	13.28	13.14	13.72	14.18	12.55	13.15	13.01	13.59	14.05
4H	2H	9.07	9.80	9.51	10.20	10.62	8.92	9.66	9.36	10.06	10.47
	3H	9.94	10.56	10.40	10.99	11.46	9.81	10.43	10.28	10.87	11.33
	4H	10.82	11.35	11.29	11.81	12.31	10.70	11.24	11.18	11.70	12.19
	6H	12.04	12.51	12.55	13.00	13.50	11.94	12.41	12.45	12.90	13.40
	8H	12.89	13.33	13.41	13.82	14.34	12.79	13.23	13.32	13.73	14.25
	12H	13.97	14.37	14.50	14.86	15.43	13.86	14.26	14.38	14.75	15.31
8H	4H	11.14	11.58	11.66	12.07	12.59	11.04	11.48	11.56	11.97	12.49
	6H	12.69	13.04	13.23	13.56	14.12	12.60	12.96	13.14	13.47	14.03
	8H	13.81	14.10	14.38	14.66	15.20	13.73	14.02	14.30	14.58	15.12
	12H	15.15	15.38	15.73	15.93	16.50	15.06	15.28	15.63	15.83	16.40
12H	4H	11.25	11.65	11.77	12.14	12.70	11.15	11.55	11.68	12.04	12.61
	6H	12.96	13.26	13.53	13.81	14.36	12.88	13.18	13.45	13.74	14.28
	8H	14.16	14.39	14.74	14.94	15.51	14.09	14.32	14.67	14.87	15.44
Variation with the observer position at spacings:											
S = 1.0H		1.7/-1.2					1.7/-1.2				
S = 1.5H		2.0/-1.2					2.0/-1.2				
S = 2.0H		2.3/-1.3					2.3/-1.3				
Standard tables:		BKBF					BKBF				
Uncorrected UGR		-3.3					-3.3				

依据CIE Publ. 117 计算 UGR, S/H = 0.25