



lumini Solucoes em Iluminacao LTDA  
www.lumini.com.br  
Email:laboratorio@lumini.com.br  
Tel:+55 11 3437-5555 Fax:+55 11 3437-5555  
Address:Rua Ferreira Viana, 716 - Socorro - São Paulo/SP

---

## lumini

---

LumCAT:

Luminaire: downled md r cob e fc

LampCAT: modulo led 25W 30K irc 90

Ballast type: led driver 700mA

Report No:

Voltage(V): 127.0000

Test No:

Current(A): 0.2270

Number of Lamps: 1

Power (W): 28.3300

Lamp flux(lm): 2800.0

PF: 0.9800

Length(mm): 130

Width(mm): 130

Phm Type: C

Height(mm): 0

---

## Photometric Results

---

Lumens(lm): 2203.91, Efficiency(%): 78.71% , Luminous Efficacy(lm/W): 77.79

Central intensity(cd): 24515.580, Maximum intensity(cd): 24515.580

Angle of maximum intensity: C=0.0  $\gamma$ =0.0

Beam angle of C0 plane : 11.86


Aveage BeamAngle(IEC 61341):11.86


---

Equipment: equipamento lumini  
Temperature(°C): 25.5


Date: 18/09/2024  
Humidity(%): 55.0%

Operator: 01  
Distance(m): 6.90

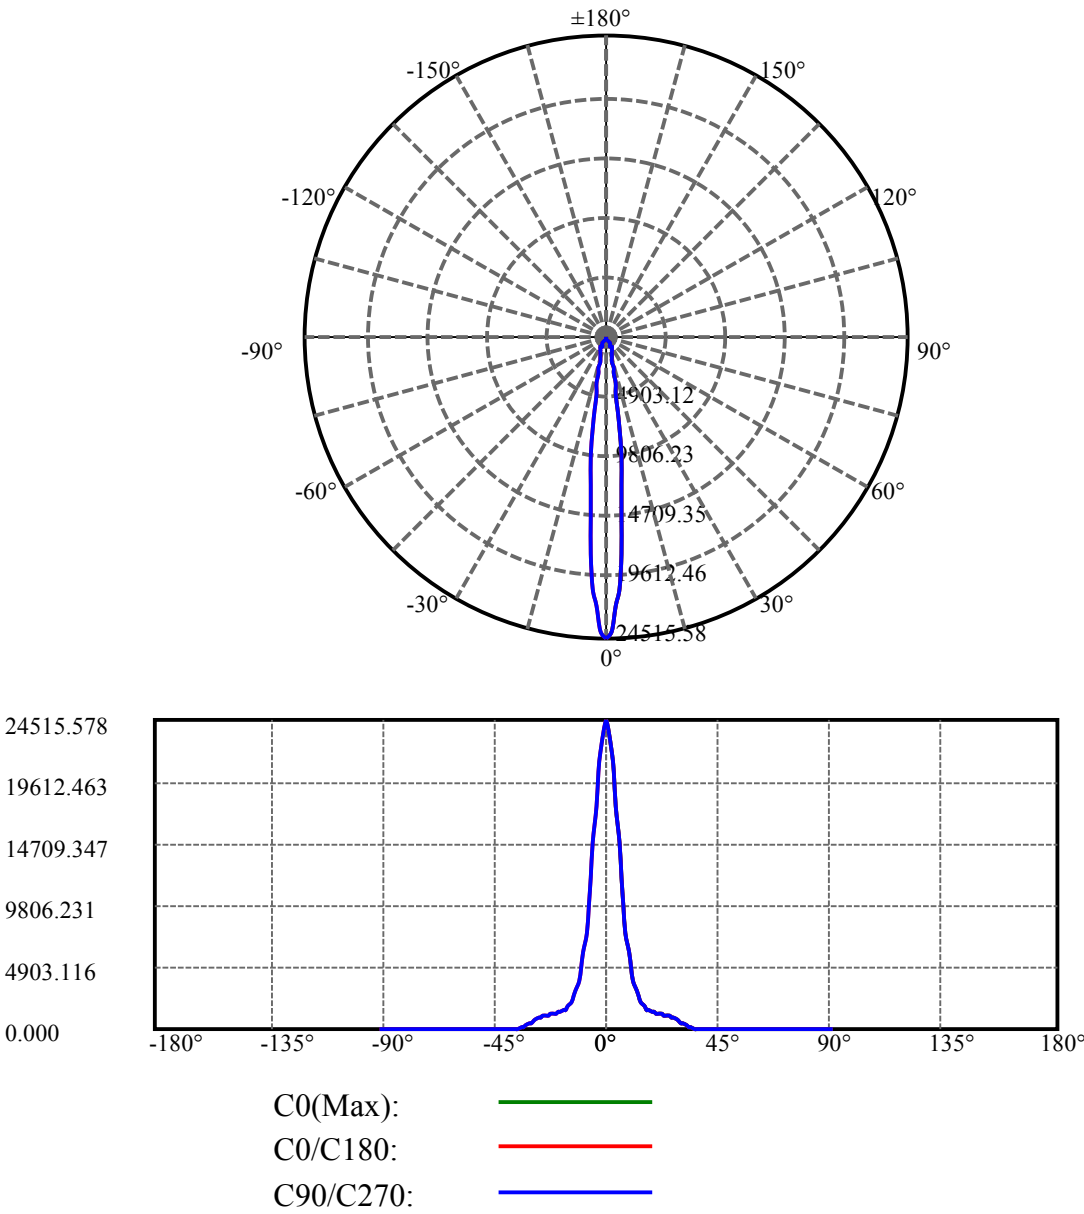

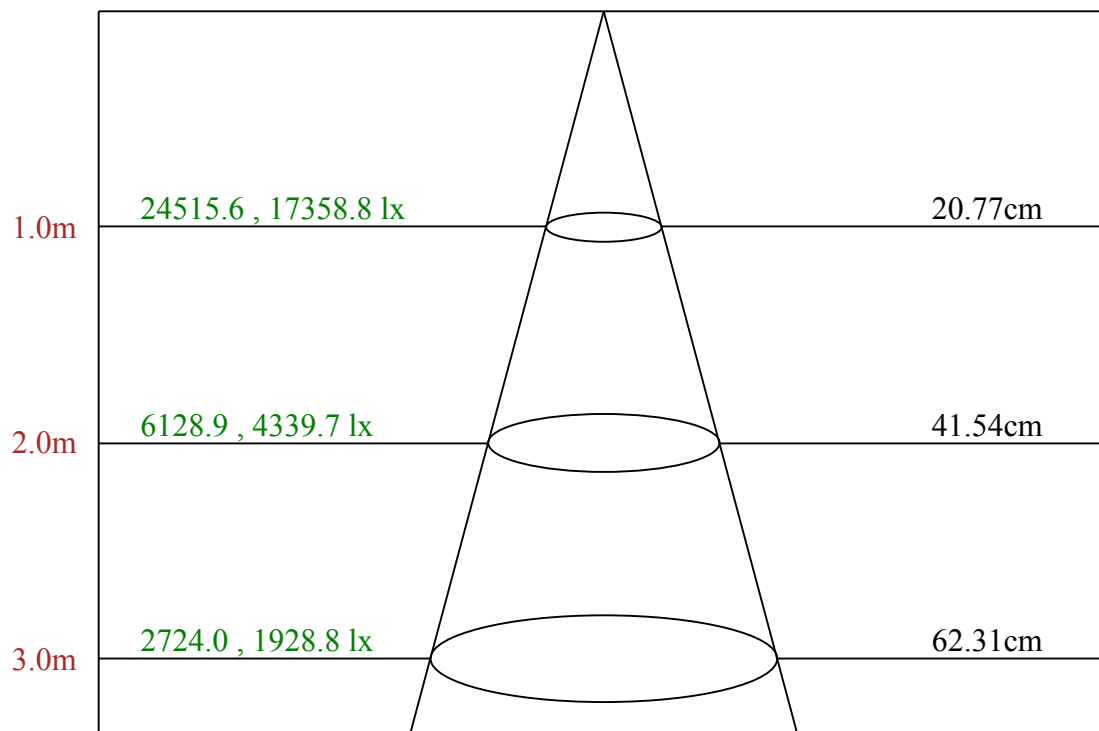

Max , Ave      Beam angle of C0 plane 11.86

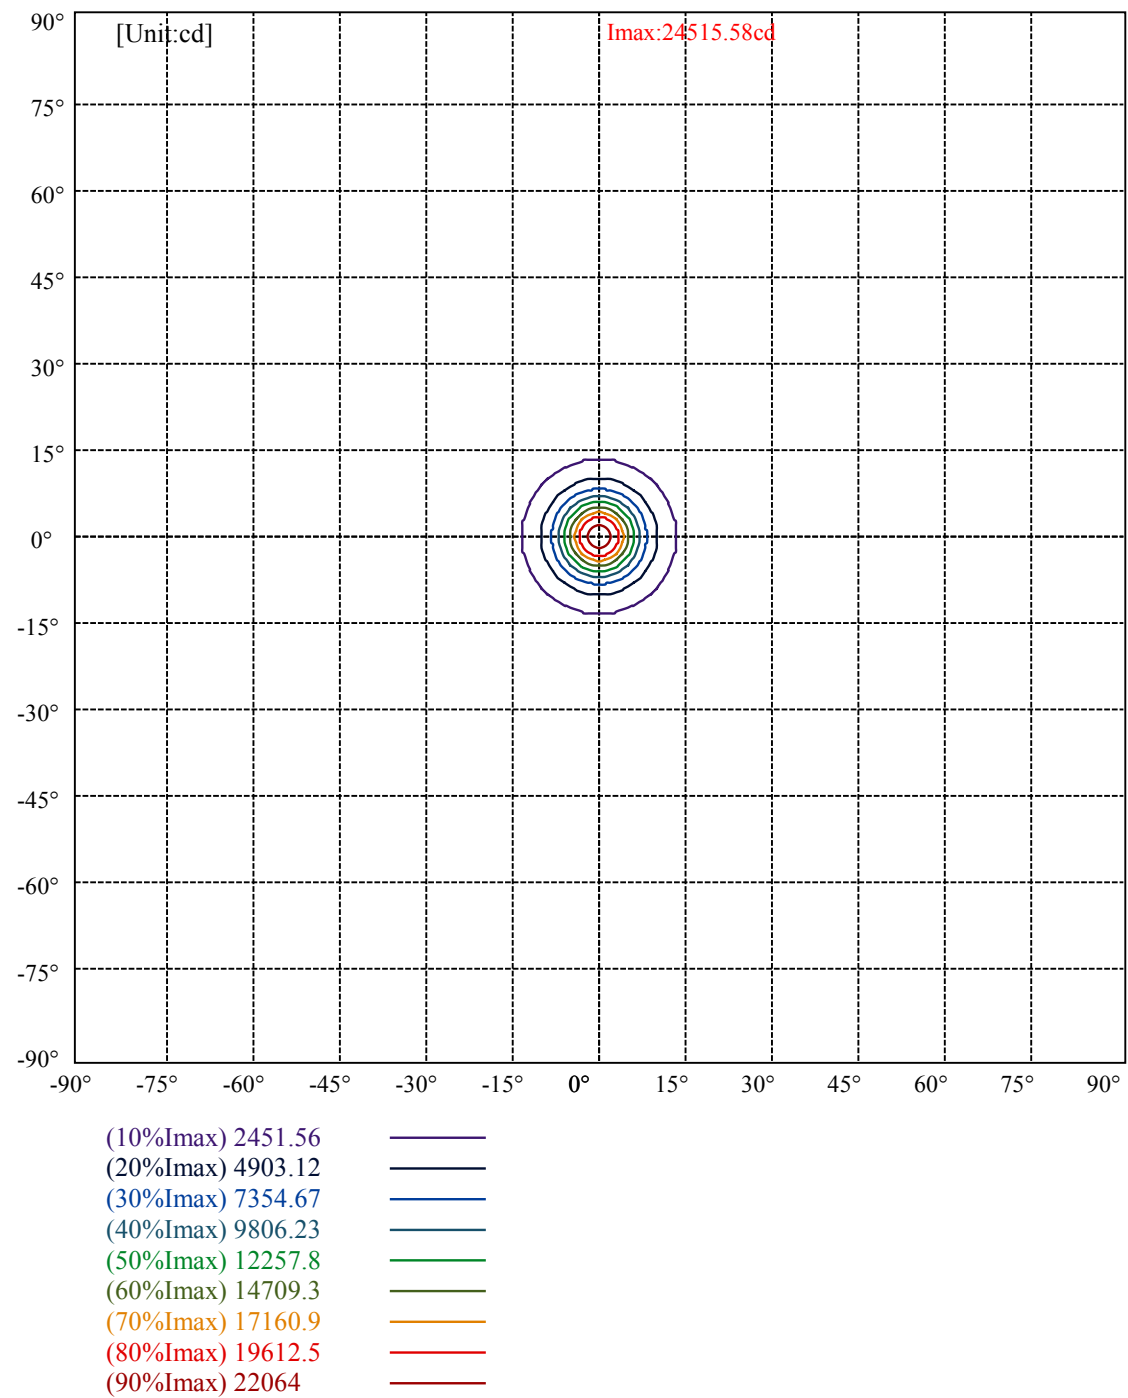

## lumini

### Luminance Limiting Curve(no luminous side)

Appendix Page: 5 Total:6

Luminance Table

$\gamma$	45	50	55	60	65	70	75	80	85
C0	1494	1385	1483	1454	1140	1120	1654	2320	4267
C45	1494	1385	1483	1454	1140	1120	1654	2320	4267
C90	1494	1385	1483	1454	1140	1120	1654	2320	4267


L(Hor)(65)	L(Ver)(65)	L45(65)	L(Hor)(75)	L(Ver)(75)	L45(75)	L(Hor)(85)	L(Ver)(85)	L45(85)
1140	1140	1140	1654	1654	1654	4267	4267	4267

Glare Table

Glare	Quality	Service Values Illuminance(lx)							
1.15	A	2000	1000	500	$\leq 300$				
1.5	B		2000	1000	500	$\leq 300$			
1.85	C			2000	1000	500	$\leq 300$		
2.2	D				2000	1000	500	$\leq 300$	
2.55	E					2000	1000	500	$\leq 300$
		a	b	c	d	e	f	g	h

Luminance Limiting Curve

$\gamma(^{\circ})$

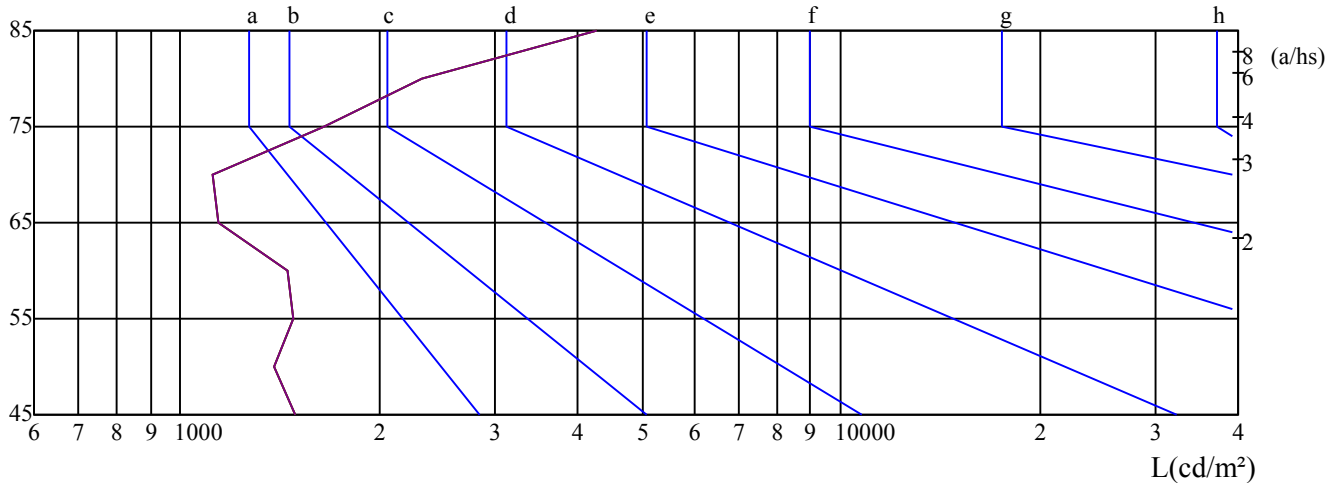

C0 ———

C45 ———

C90 ———

Equipment: equipamento lumini  
Temperature( $^{\circ}\text{C}$ ): 25.5

Date: 18/09/2024  
Humidity(%): 55.0%

Operator: 01  
Distance(m): 6.90

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	6.38	7.30	6.75	7.61	7.92	6.38	7.30	6.75	7.61	7.92
	3H	6.78	7.59	7.17	7.93	8.28	6.78	7.59	7.17	7.93	8.28
	4H	7.30	8.05	7.70	8.41	8.78	7.30	8.05	7.70	8.41	8.78
	6H	8.18	8.86	8.60	9.24	9.64	8.18	8.86	8.60	9.24	9.64
	8H	8.74	9.39	9.16	9.78	10.18	8.74	9.39	9.16	9.78	10.18
	12H	9.45	10.07	9.88	10.47	10.88	9.45	10.07	9.88	10.47	10.88
4H	2H	6.38	7.13	6.78	7.48	7.85	6.38	7.13	6.78	7.48	7.85
	3H	6.97	7.60	7.40	8.00	8.42	6.97	7.60	7.40	8.00	8.42
	4H	7.80	8.34	8.24	8.77	9.22	7.80	8.34	8.24	8.77	9.22
	6H	8.96	9.44	9.44	9.89	10.35	8.96	9.44	9.44	9.89	10.35
	8H	9.72	10.17	10.21	10.63	11.10	9.72	10.17	10.21	10.63	11.10
	12H	10.67	11.07	11.16	11.53	12.05	10.67	11.07	11.16	11.53	12.05
8H	4H	8.10	8.54	8.59	9.00	9.48	8.10	8.54	8.59	9.00	9.48
	6H	9.57	9.93	10.07	10.41	10.92	9.57	9.93	10.07	10.41	10.92
	8H	10.59	10.89	11.12	11.41	11.91	10.59	10.89	11.12	11.41	11.91
	12H	11.78	12.01	12.33	12.53	13.05	11.78	12.01	12.33	12.53	13.05
12H	4H	8.20	8.60	8.69	9.06	9.58	8.20	8.60	8.69	9.06	9.58
	6H	9.82	10.12	10.35	10.64	11.14	9.82	10.12	10.35	10.64	11.14
	8H	10.92	11.14	11.46	11.66	12.19	10.92	11.14	11.46	11.66	12.19
Variation with the observer position at spacings:											
S = 1.0H		4.2/-2.5					4.2/-2.5				
S = 1.5H		5.0/-2.0					5.0/-2.0				
S = 2.0H		5.6/-1.4					5.6/-1.4				
Standard tables:		BKBF					BKBF				
Uncorrected UGR		-5.5					-5.5				

依据CIE Publ. 117 计算 UGR, S/H = 0.25