



lumini Solucoes em Iluminacao LTDA
www.lumini.com.br
Email: laboratorio@lumini.com.br
Tel: +55 11 3437-5555 Fax: +55 11 3437-5555
Address: Rua Ferreira Viana, 716 - Socorro - São Paulo/SP

lumini

LumCAT:

Luminaire: concentra flex 50 c serie 3 fa

LampCAT: 3x modulo led 6W 30K irc 90

Ballast type: led driver 700mA

Report No:

Voltage(V): 127.7700

Test No:

Current(A): 0.1570

Number of Lamps: 1

Power (W): 19.8800

Lamp flux(lm): 2145.0

PF: 0.9890

Length(mm): 550

Width(mm): 40

Phm Type: C

Height(mm): 0

Photometric Results

Lumens(lm): 1349.71, Efficiency(%): 62.92% , Luminous Efficacy(lm/W): 67.89

Central intensity(cd): 1758.475, Maximum intensity(cd): 1758.475

Angle of maximum intensity: C=0.0 γ =0.0



Beam angle of C0 plane : 52.39

Average BeamAngle(IEC 61341): 52.39


Equipment: equipamento lumini
Temperature(°C): 25.5

Date: 16/05/2025
Humidity(%): 60.0%


Operator: 01
Distance(m): 6.90

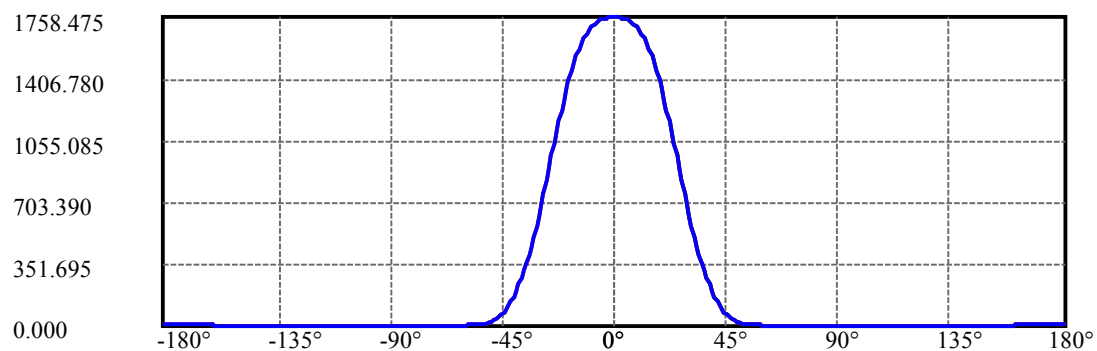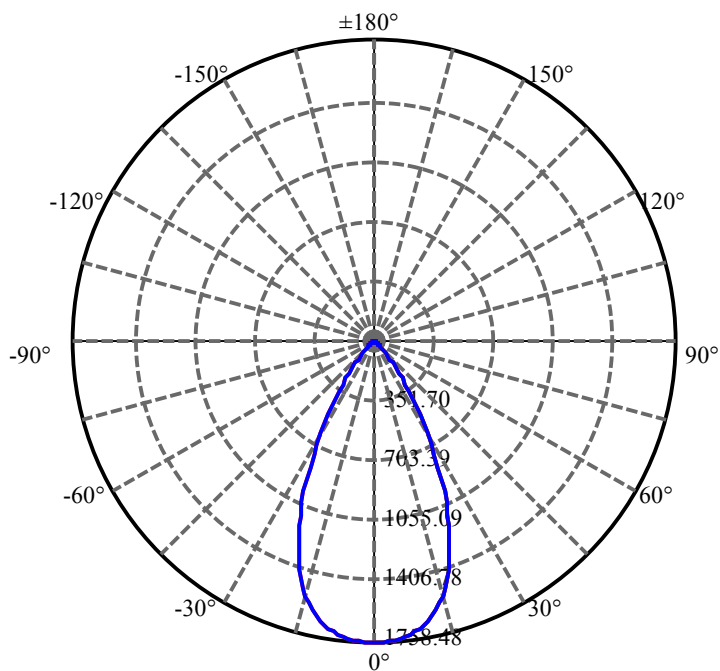

C0(Max):
C0/C180:
C90/C270:

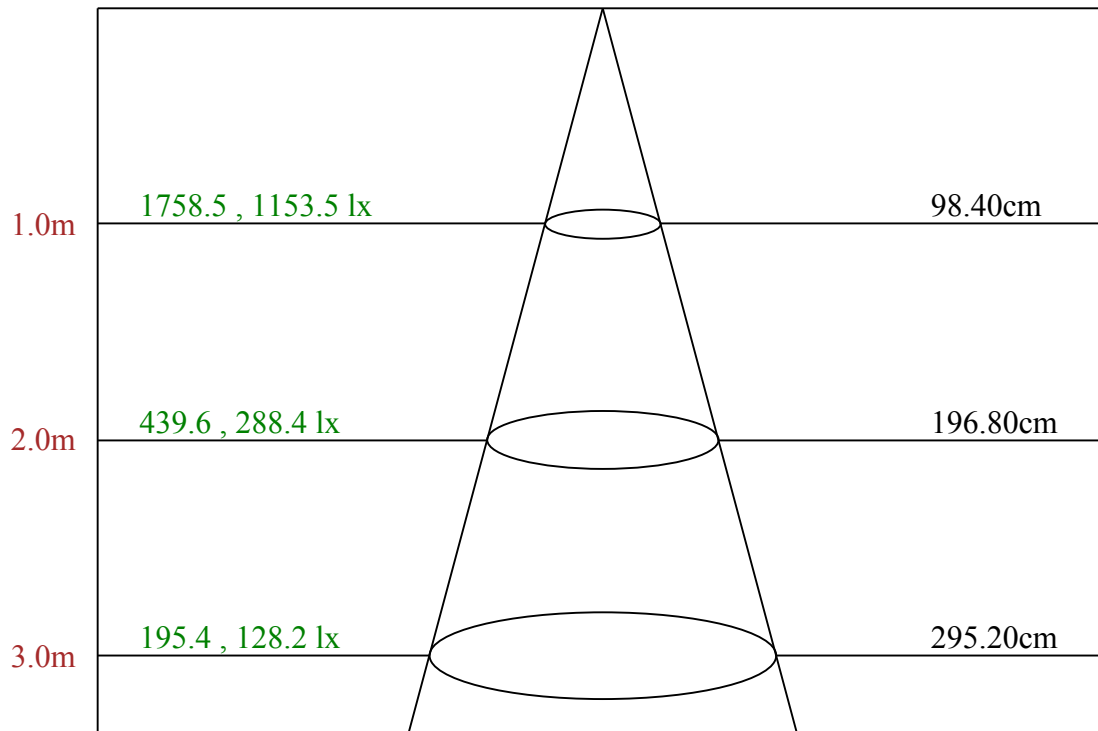

Max , Ave Beam angle of C0 plane 52.39

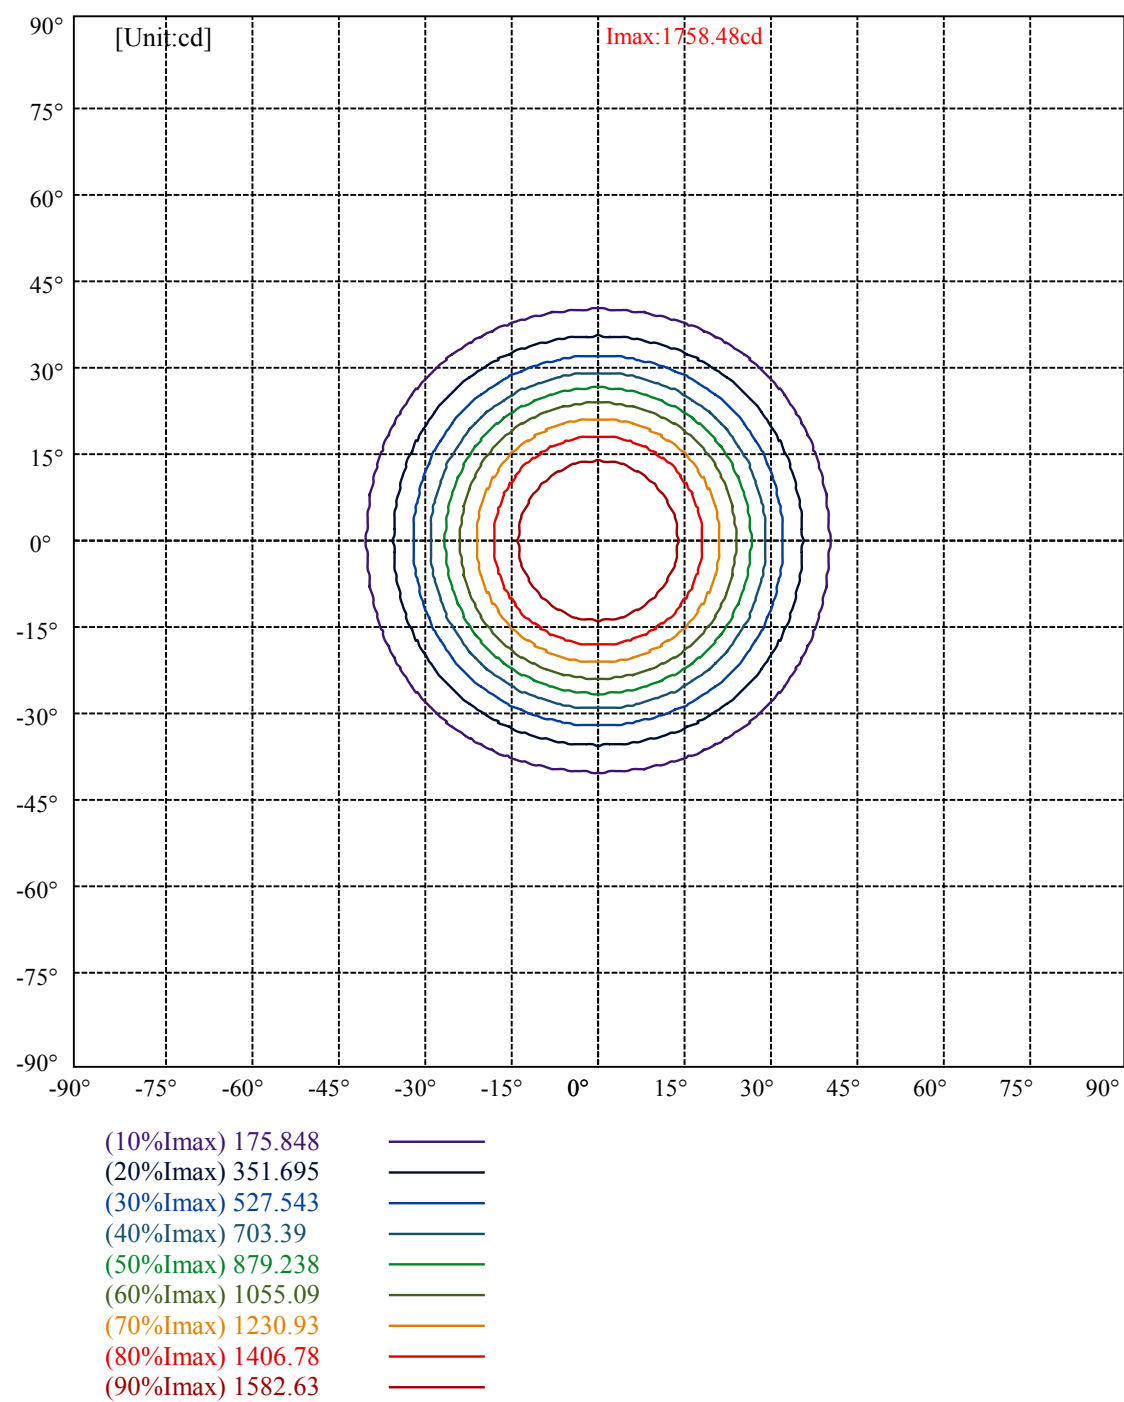

lumini

Luminance Limiting Curve(no luminous side)

Appendix Page: 5 Total:6

Luminance Table

γ	45	50	55	60	65	70	75	80	85
C0	4147	1289	543	470	475	524	646	938	1831
C45	4147	1289	543	470	475	524	646	938	1831
C90	4147	1289	543	470	475	524	646	938	1831


L(Hor)(65)	L(Ver)(65)	L45(65)	L(Hor)(75)	L(Ver)(75)	L45(75)	L(Hor)(85)	L(Ver)(85)	L45(85)
475	475	475	646	646	646	1831	1831	1831

Glare Table

Glare	Quality	Service Values Illuminance(lx)							
1.15	A	2000	1000	500	≤ 300				
1.5	B		2000	1000	500	≤ 300			
1.85	C			2000	1000	500	≤ 300		
2.2	D				2000	1000	500	≤ 300	
2.55	E					2000	1000	500	≤ 300
		a	b	c	d	e	f	g	h

Luminance Limiting Curve

$\gamma(^{\circ})$

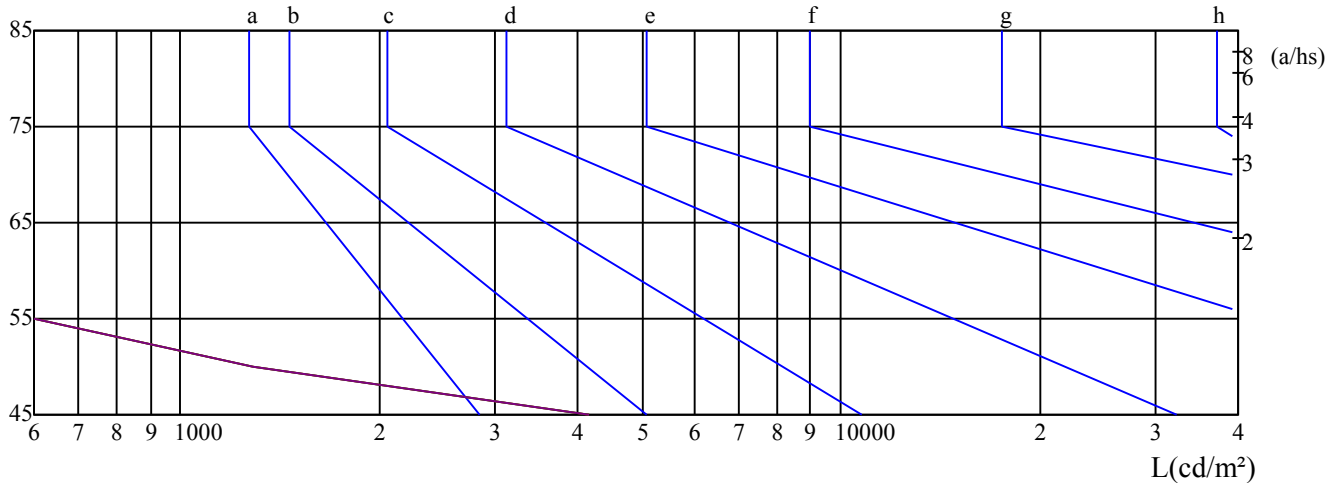

C0 ———

C45 ———

C90 ———

Equipment: equipamento lumini
Temperature($^{\circ}\text{C}$): 25.5

Date: 16/05/2025
Humidity(%): 60.0%

Operator: 01
Distance(m): 6.90

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	15.79	16.73	16.19	17.08	17.45	16.24	17.18	16.64	17.53	17.90
	3H	15.60	16.43	16.02	16.81	17.20	16.05	16.88	16.47	17.26	17.65
	4H	15.51	16.28	15.95	16.67	17.09	15.96	16.73	16.39	17.12	17.53
	6H	15.45	16.16	15.91	16.57	17.02	15.89	16.60	16.35	17.01	17.46
	8H	15.41	16.08	15.86	16.50	16.96	15.84	16.51	16.30	16.94	17.39
	12H	15.38	16.02	15.84	16.45	16.91	15.81	16.45	16.27	16.88	17.34
4H	2H	15.48	16.25	15.92	16.65	17.06	15.93	16.70	16.37	17.09	17.51
	3H	15.26	15.90	15.72	16.34	16.80	15.70	16.35	16.16	16.78	17.24
	4H	15.21	15.77	15.68	16.23	16.72	15.65	16.21	16.12	16.67	17.16
	6H	15.13	15.62	15.63	16.10	16.60	15.56	16.05	16.06	16.54	17.03
	8H	15.12	15.57	15.64	16.07	16.59	15.54	16.00	16.06	16.49	17.01
	12H	15.16	15.58	15.68	16.06	16.63	15.57	15.99	16.09	16.47	17.04
8H	4H	15.02	15.48	15.54	15.97	16.49	15.46	15.91	15.98	16.41	16.93
	6H	14.95	15.33	15.49	15.84	16.40	15.38	15.75	15.92	16.26	16.82
	8H	15.03	15.34	15.59	15.89	16.43	15.44	15.75	16.00	16.30	16.85
	12H	15.12	15.36	15.70	15.91	16.48	15.51	15.75	16.09	16.30	16.87
12H	4H	14.97	15.39	15.50	15.88	16.44	15.41	15.83	15.94	16.32	16.88
	6H	14.96	15.27	15.52	15.82	16.36	15.38	15.69	15.94	16.24	16.78
	8H	15.01	15.25	15.58	15.80	16.36	15.41	15.65	15.99	16.20	16.77
Variation with the observer position at spacings:											
S = 1.0H		4.9/-10.7					4.9/-10.7				
S = 1.5H		7.5/-8.8					7.5/-8.8				
S = 2.0H		9.3/-7.5					9.3/-7.5				
Standard tables:		BK1					BK1				
Uncorrected UGR		-5.1					-5.1				

依据CIE Publ. 117 计算 UGR, S/H = 0.25