



lumini Solucoes em Iluminacao LTDA
www.lumini.com.br
Email:laboratorio@lumini.com.br
Tel:+55 11 3437-5555 Fax:+55 11 3437-5555
Address:Rua Ferreira Viana, 716 - Socorro - São Paulo/SP

lumini

LumCAT:

Luminaire: solum 12V fm

LampCAT: modulo led 19W 12Vdc 27K irc 90

Ballast type: led line driver 12Vdc

Report No:

Voltage(V): 123.0000

Test No:

Current(A): 0.1950

Number of Lamps: 1

Power (W): 23.9850

Lamp flux(lm): 1440.0

PF: 0.0000

Length(mm): 124

Width(mm): 124

Phm Type: C

Height(mm): 0

Photometric Results

Lumens(lm): 1030.60, Efficiency(%): 71.57% , Luminous Efficacy(lm/W): 42.97

Central intensity(cd): 1588.662, Maximum intensity(cd): 1588.662

Angle of maximum intensity: C=0.0 γ =0.0


Beam angle of C0 plane : 43.54


Aveage BeamAngle(IEC 61341):43.54

Equipment: equipamento lumini
Temperature(°C): 25.5


Date: 31/01/2025
Humidity(%): 78.0%

Operator: 01
Distance(m): 6.90

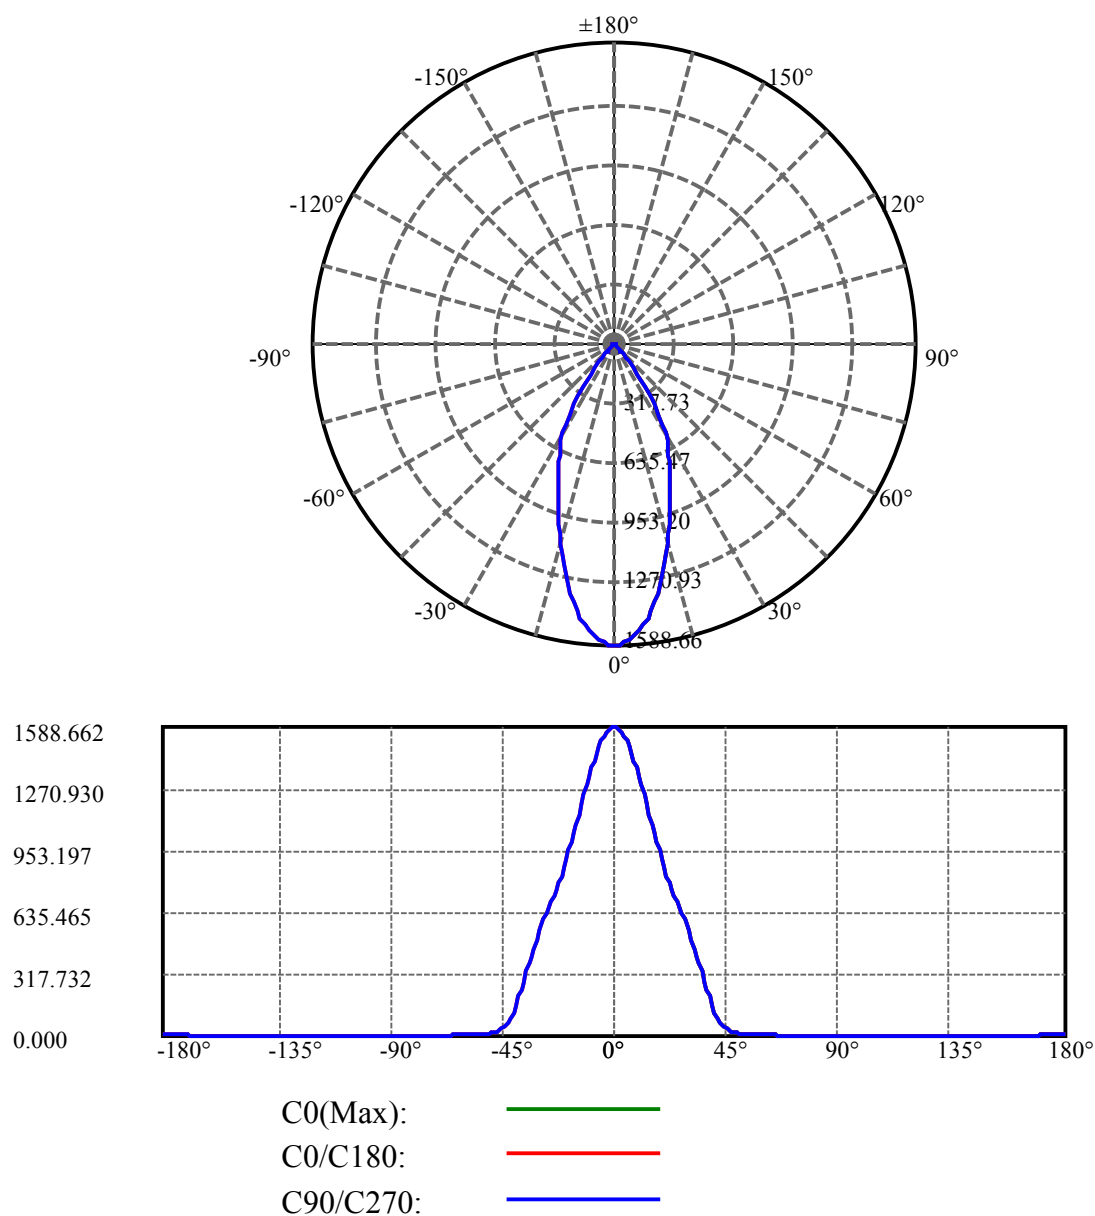

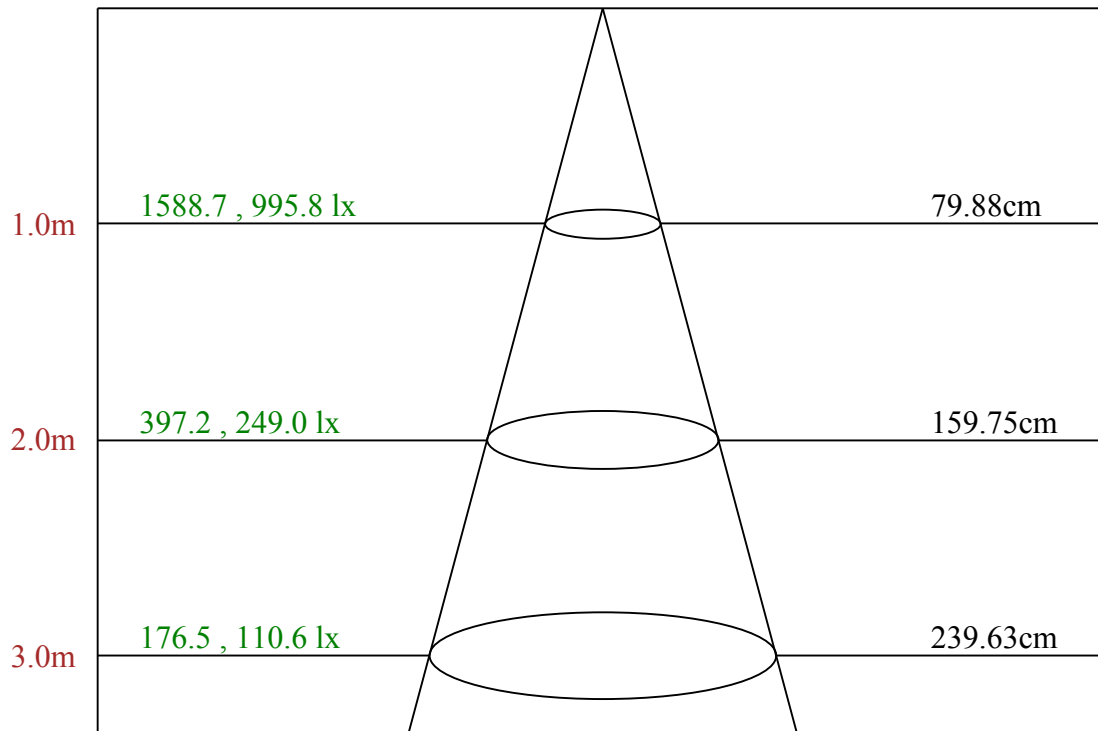

Max , Ave Beam angle of C0 plane 43.54

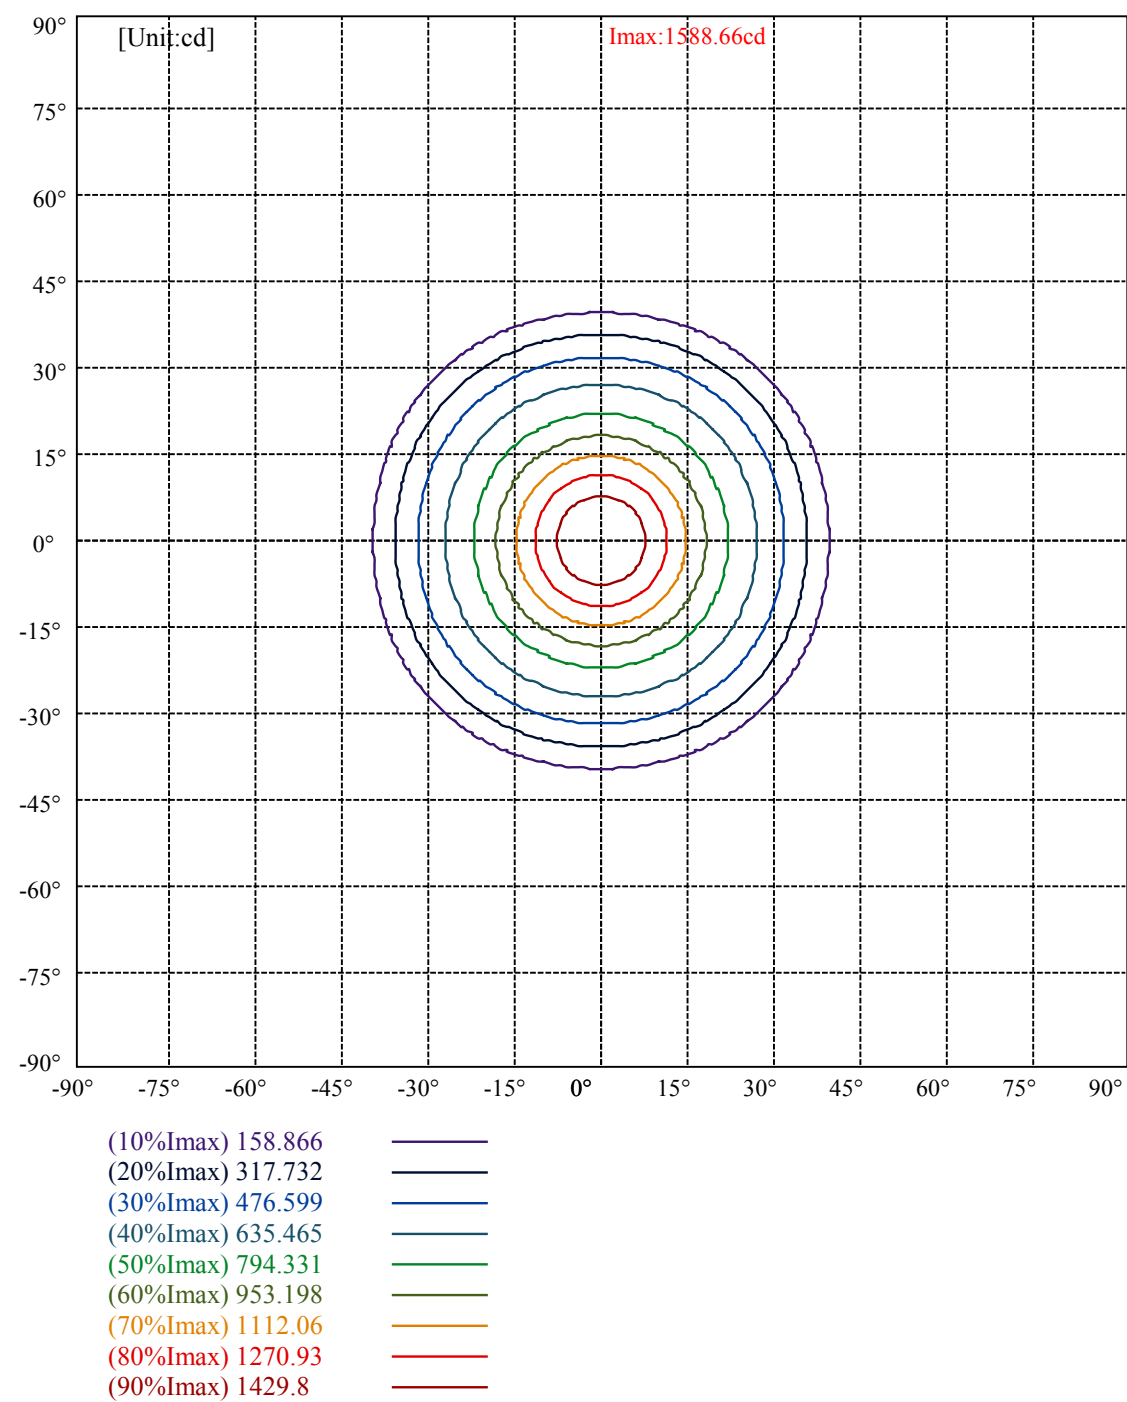

Luminance Table


γ	45	50	55	60	65	70	75	80	85
C0	3675	1394	952	805	741	731	805	1099	1958
C45	3675	1394	952	805	741	731	805	1099	1958
C90	3675	1394	952	805	741	731	805	1099	1958

L(Hor)(65)	L(Ver)(65)	L45(65)	L(Hor)(75)	L(Ver)(75)	L45(75)	L(Hor)(85)	L(Ver)(85)	L45(85)
741	741	741	805	805	805	1958	1958	1958

Glare Table

Glare	Quality	Service Values Illuminance(lx)							
1.15	A	2000	1000	500	≤ 300				
1.5	B		2000	1000	500	≤ 300			
1.85	C			2000	1000	500	≤ 300		
2.2	D				2000	1000	500	≤ 300	
2.55	E					2000	1000	500	≤ 300
		a	b	c	d	e	f	g	h

Luminance Limiting Curve

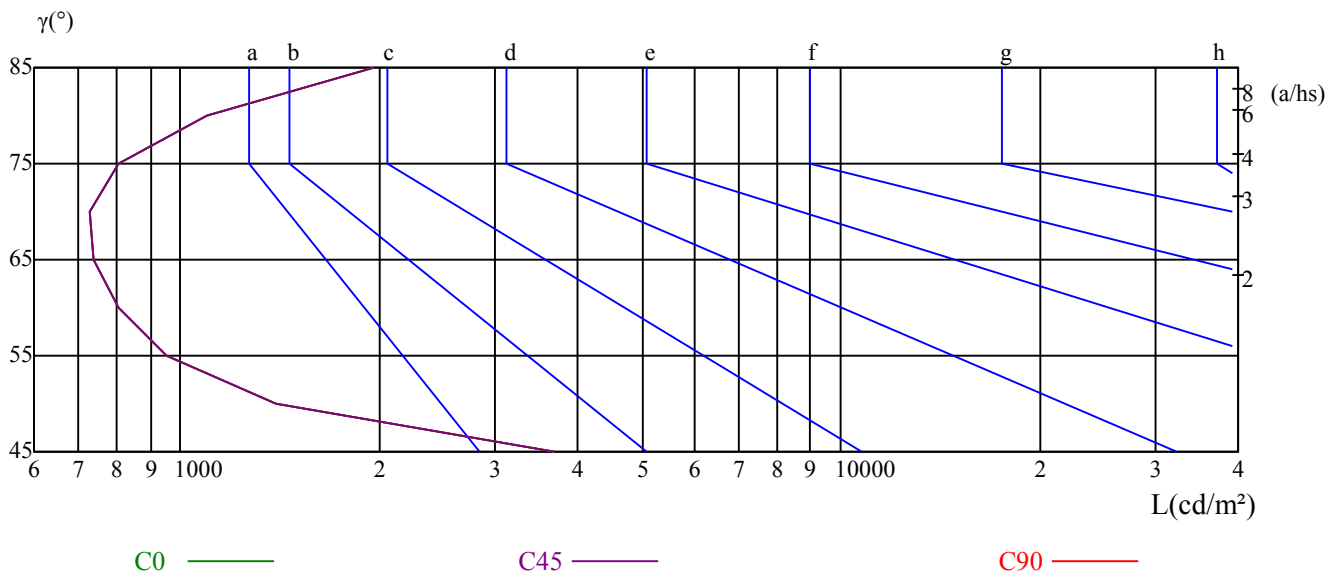

Illumination assessment according UGR											
Rf of Ceiling	70	70	50	50	30	70	70	50	50	30	
Rf of Wall	50	30	50	30	30	50	30	50	30	30	
Rf of Floor	20	20	20	20	20	20	20	20	20	20	
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	14.03	14.97	14.43	15.32	15.68	14.03	14.96	14.43	15.31	15.68
	3H	13.88	14.71	14.30	15.08	15.47	13.87	14.70	14.29	15.08	15.47
	4H	13.81	14.58	14.25	14.97	15.38	13.81	14.58	14.24	14.97	15.38
	6H	13.79	14.50	14.25	14.91	15.35	13.79	14.49	14.24	14.91	15.35
	8H	13.78	14.45	14.23	14.87	15.32	13.77	14.44	14.22	14.86	15.31
	12H	13.79	14.43	14.25	14.86	15.32	13.78	14.41	14.24	14.84	15.30
4H	2H	13.74	14.51	14.17	14.90	15.31	13.73	14.50	14.17	14.89	15.31
	3H	13.57	14.21	14.03	14.64	15.11	13.57	14.21	14.03	14.64	15.10
	4H	13.56	14.12	14.03	14.57	15.07	13.56	14.11	14.03	14.57	15.06
	6H	13.55	14.04	14.05	14.52	15.02	13.54	14.03	14.05	14.52	15.01
	8H	13.60	14.05	14.11	14.54	15.06	13.58	14.04	14.10	14.53	15.05
	12H	13.70	14.11	14.22	14.60	15.16	13.67	14.09	14.20	14.58	15.14
8H	4H	13.40	13.85	13.92	14.35	14.86	13.40	13.85	13.92	14.34	14.86
	6H	13.44	13.81	13.97	14.32	14.87	13.43	13.80	13.97	14.31	14.87
	8H	13.59	13.90	14.16	14.46	15.00	13.58	13.89	14.14	14.44	14.98
	12H	13.79	14.03	14.36	14.58	15.14	13.76	14.00	14.33	14.55	15.11
12H	4H	13.36	13.78	13.88	14.27	14.83	13.36	13.78	13.88	14.26	14.83
	6H	13.46	13.77	14.02	14.32	14.86	13.45	13.76	14.02	14.32	14.86
	8H	13.61	13.85	14.18	14.40	14.96	13.59	13.83	14.16	14.38	14.94
Variation with the observer position at spacings:											
S = 1.0H		5.3/-9.4					5.3/-9.4				
S = 1.5H		7.9/-8.2					7.9/-8.2				
S = 2.0H		9.7/-7.1					9.7/-7.1				
Standard tables:		BK1					BK1				
Uncorrected UGR		-4.1					-4.1				

依据CIE Publ. 117 计算 UGR, S/H = 0.25